

ADD
YOUR LOGO
HERE

RETAIL FIREWORKS STAND INSPECTION CHECKLIST

Inspecting Agency:	Phone Number:
Inspector:	Date:

Contact Person:	Phone Number:
Property Name:	Property Address:
Structure Type <input type="checkbox"/> Fireworks Stand <input type="checkbox"/> Fireworks Tent	Local Permit Number

Retail Fireworks Stand WAC Requirements WAC 212-17-21509 to 212-17-21519

WAC Reference

ADMINISTRATION

- | | |
|---|--|
| <input type="checkbox"/> A State Fire Marshal's License posted.
<input type="checkbox"/> Local Permit posted.
<input type="checkbox"/> Proof of insurance coverage as specified in RCW 70.74.
<input type="checkbox"/> Written Authorization from the property owner which allows use of the site.
<input type="checkbox"/> A Site Plan of the proposed location of the fireworks stand shall be drawn to scale on an 8 ½ x 11 diagram. This diagram shall show the size of the stand; distance from the stand to structures, buildings, fire hydrants, other stands, streets, and parking areas.
<input type="checkbox"/> Posted Signage: List of legal fireworks, No Smoking, and Photo ID Required. | 212-17-185(1)

212-17-185(2) |
|---|--|

STRUCTURE

- | | |
|--|--|
| <input type="checkbox"/> Retail sales of fireworks and other products which are holiday related shall be from buildings used for no other purpose; OR,
<input type="checkbox"/> A permanent structure which meets provisions of WAC 212-17-21505(3).
<input type="checkbox"/> Temporary, stable structures.
<input type="checkbox"/> Tents, canopies, or structures utilizing temporary membrane materials made from fire retardant or treated with fire retardant.
<input type="checkbox"/> Electrical service shall be installed in accordance to NEC & AHJ. | 212-17-213

212-17-21513 |
|--|--|


STAND LOCATION

- | | |
|--|--------------|
| <input type="checkbox"/> Not more than 150 feet from a private way/public road, street, or highway.
<input type="checkbox"/> Fireworks stands shall be at least 100 feet apart or separated by a road, street, or highway not less than 50 feet.
<input type="checkbox"/> Meets Minimum Clearances.
Retail Fireworks Stands - Minimum Clearances | 212-17-21509 |
|--|--------------|
- | | Buildings | Combustibles | Property Line | Parking | Public Road* | Private Way |
|----------------|--------------------|--------------------|---------------|---------|--------------|-------------|
| BACK OF STAND | 20 FT. | 20 FT. | 5 FT. | 20 FT. | 20 FT. | 5 FT. |
| SIDE OF STAND | 20 FT. | 20 FT. | 5 FT. | 20 FT. | 20 FT. | 5 FT. |
| FRONT OF STAND | 40 FT.
20 FT.** | 40 FT.
20 FT.** | 20 FT. | 20 FT. | 20 FT. | 20 FT. |
- *Measured from the outer edge of the nearest traffic lane.
 **If stand is equipped with 135 fusible links which will automatically close all sales doors in case of fire. Exception: Fuel for generators, fuel within the tanks of vehicles.

ADD
YOUR LOGO
HERE

EXTERIOR	WAC Reference
<input type="checkbox"/> Area around stand kept free of dry grass, dry brush, and combustible debris. <input type="checkbox"/> No parking within 20 feet, except when delivering and unloading fireworks. <input type="checkbox"/> Sell <100' from storage & dispensing of flammables. <input type="checkbox"/> No fireworks may be discharged within 100 feet of a stand. <input type="checkbox"/> NO SMOKING signs with at least 4" letters, posted.	212-17-21511
GENERATOR	
<input type="checkbox"/> Generator at least 20' from stand. <input type="checkbox"/> No high grass, weeds, trash near generator. <input type="checkbox"/> 6 BC extinguisher on site for generator.	212-17-21513(4)
INTERIOR	
<input type="checkbox"/> Clear aisle ways of at least 24 inches. <input type="checkbox"/> Customers permitted inside only when greater than four hundred square feet. <input type="checkbox"/> Temporary stands shall have two exits at least 28" in width. <input type="checkbox"/> Two approved pressurized 2 ½ gallon water-type fire extinguishers. <input type="checkbox"/> No open flames or flame equipment inside.	212-17-21515
STAND OPERATIONS	
<input type="checkbox"/> Stand shall be secured when unoccupied if fireworks are kept in the stand. <input type="checkbox"/> At least one person 18 years of age must be present at all times. Sellers shall require proof of age. <input type="checkbox"/> No person under the age of 16 shall be allowed within a retail fireworks stand (other than customers). <input type="checkbox"/> Fireworks not sold or offered to children less than 16 years of age. <input type="checkbox"/> A sign reading "no sale of fireworks to person under the age of sixteen years." <input type="checkbox"/> "PHOTO ID REQUIRED" in letters at least two inches high shall be posted. Sellers shall require proof of age <input type="checkbox"/> No sleeping inside a retail fireworks stand or temporary fireworks storage facility. <input type="checkbox"/> Location of the nearest telephone must be posted and workers aware of it. <input type="checkbox"/> Local emergency phone number posted. <input type="checkbox"/> No cooking is permitted in a retail fireworks stand or temporary storage structure. WAC 212-17-21517(8)	212-17-21515
CLEAN UP	
<input type="checkbox"/> At the end of the selling period, all fireworks must remain in the retail stand or temporary storage authorized by the permit or AHJ (or designee) until returned to the supplier. <input type="checkbox"/> Cities and counties may require a clean-up bond.	212-17-21519
Inspection by:	Inspection Date:
<input type="checkbox"/> Stand Approved <input type="checkbox"/> Stand Not Approved	
Re-inspection By:	Re-inspection Date:
<input type="checkbox"/> Stand Approved After Re-inspection	<input type="checkbox"/> Stand Not Approved After Re-inspection
Comments:	

Washington Fireworks Stand Requirements

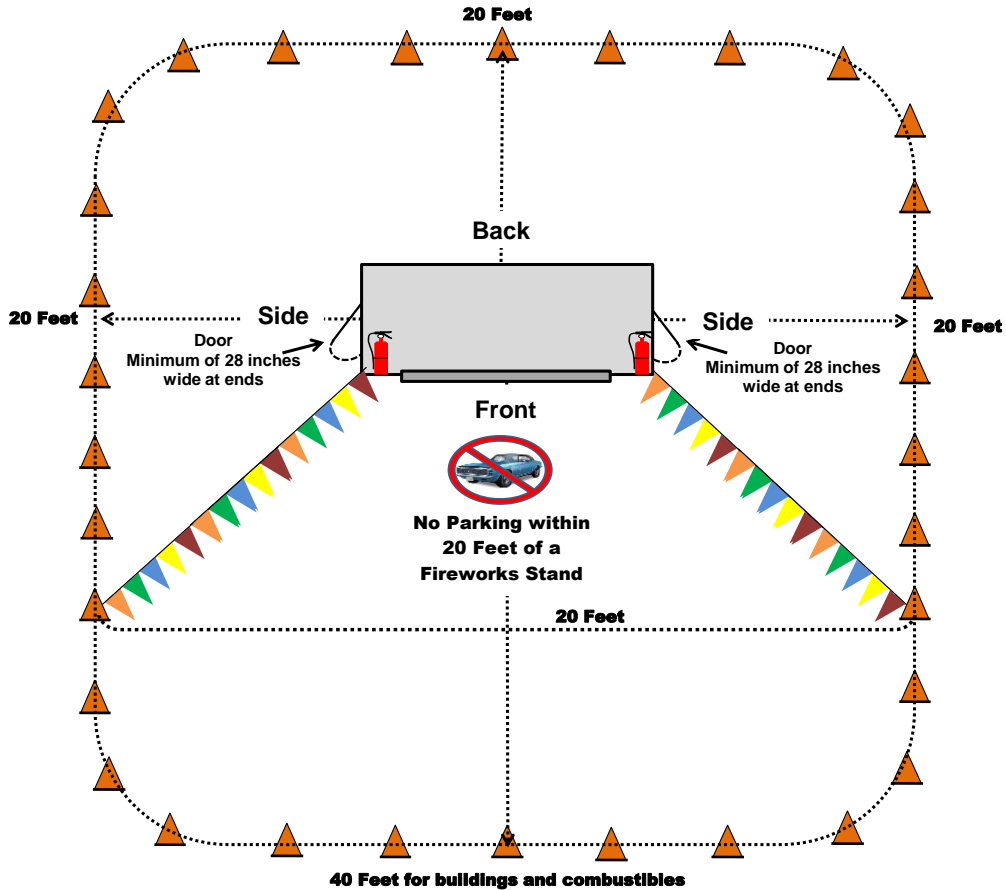

Side



Front



Side

Fire Extinguishers:

A minimum of two fire extinguishers is required



Back

Required Signage

No Smoking: 1 each side door

Exit: 1 each side door

No Discharge of Fireworks: 1 each side

Retail Fireworks Stands - Minimum Clearances

	Buildings	Combustibles	Generator (with less than 5 Gallons of Fuel)	Property Line	Parking	Motor Vehicle Traffic Public Road ⁽¹⁾	Motor Vehicle Traffic Private Road
Back of Stand	20 Feet	20 Feet	20 Feet	5 Feet	20 Feet	20 Feet	5 Feet
Side of Stand	20 Feet	20 Feet	20 Feet	5 Feet	20 Feet	20 Feet	5 Feet
Front of Stand	40 Feet	40 Feet	20 Feet	20 Feet	20 Feet	20 Feet	20 Feet
	20 Feet ⁽²⁾	20 Feet ⁽²⁾					

Note:


Clearance distances are not cumulative.

(1) Measured from the outer edge of the nearest traffic lane.


(2) If stand is equipped with 135 fusible links which will automatically close all sales doors in case of fire, or is equipped with a wire-mesh screen with openings of not more than one inch which covers not less than 90% of all sales openings.

Retail fireworks stands shall not be located closer than one hundred feet from any motor vehicle dispensing station, retail propane dispensing station, flammable liquid storage, or combustible liquid storage. Retail fireworks stands shall not be located closer than three hundred feet from any bulk storage of flammable or combustible liquid or gas, including bulk plant dispensing areas.

Washington Fireworks Tent Requirements

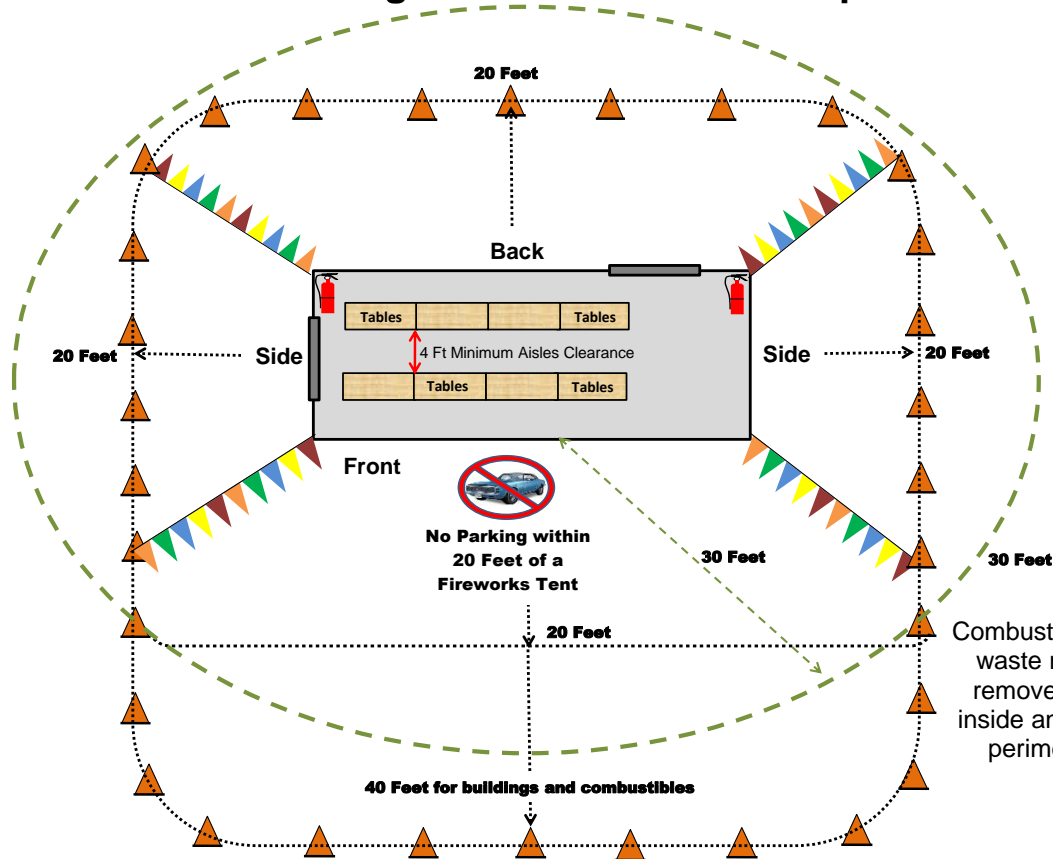

Combustible vegetation and waste material shall be removed and kept clear inside and within a 30-foot perimeter of the tent.

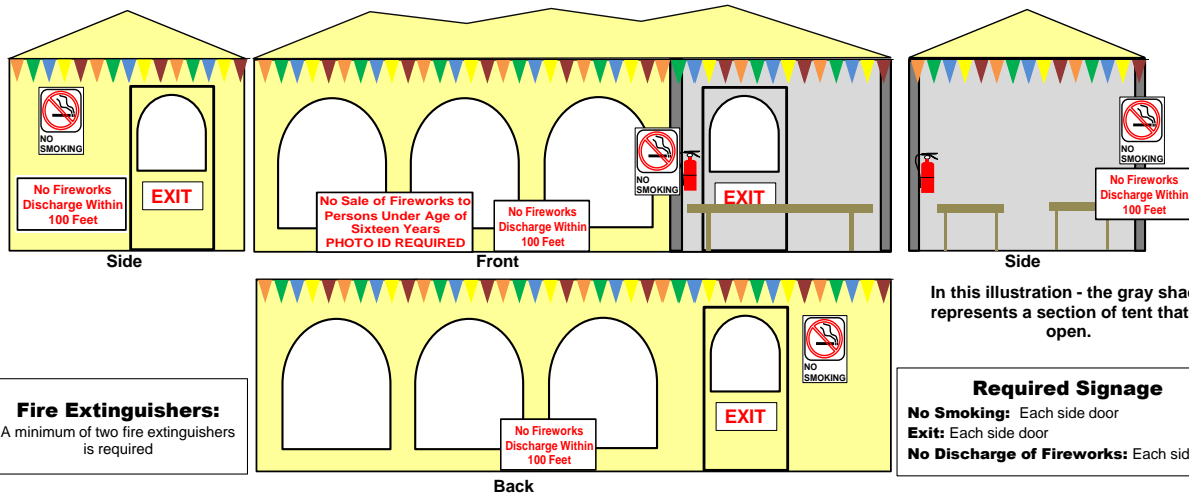

Fire Extinguishers:
A minimum of two fire extinguishers is required

Retail Fireworks Stands - Minimum Clearances

	Buildings	Combustibles	Generator (with less than 5 Gallons of Fuel)	Property Line	Parking	Motor Vehicle Traffic Public Road ⁽¹⁾	Motor Vehicle Traffic Private Road
Back of Stand	20 Feet	20 Feet	20 Feet	5 Feet	20 Feet	20 Feet	5 Feet
Side of Stand	20 Feet	20 Feet	20 Feet	5 Feet	20 Feet	20 Feet	5 Feet
Front of Stand	40 Feet	40 Feet	20 Feet	20 Feet	20 Feet	20 Feet	20 Feet
	20 Feet ⁽²⁾	20 Feet ⁽²⁾					

Note:

Clearance distances are not cumulative.

(1) Measured from the outer edge of the nearest traffic lane.

(2) If stand is equipped with 135 fusible links which will automatically close all sales doors in case of fire, or is equipped with a wire-mesh screen with openings of not more than one inch which covers not less than 90% of all sales openings.

Retail fireworks stands shall not be located closer than one hundred feet from any motor vehicle dispensing station, retail propane dispensing station, flammable liquid storage, or combustible liquid storage. Retail fireworks stands shall not be located closer than three hundred feet from any bulk storage of flammable or combustible liquid or gas, including bulk plant dispensing areas.